

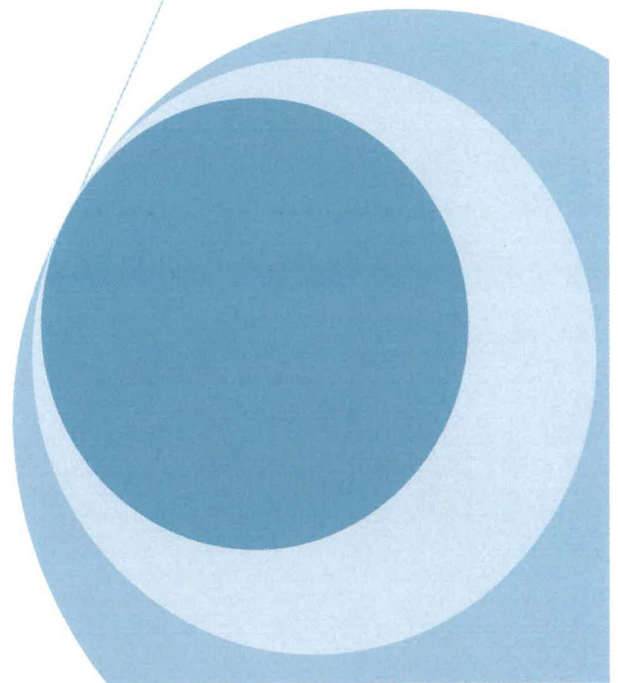


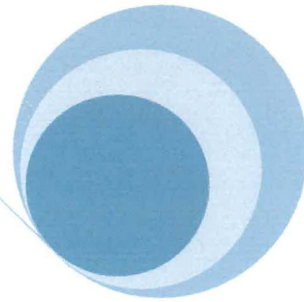

Section 400 Pathways

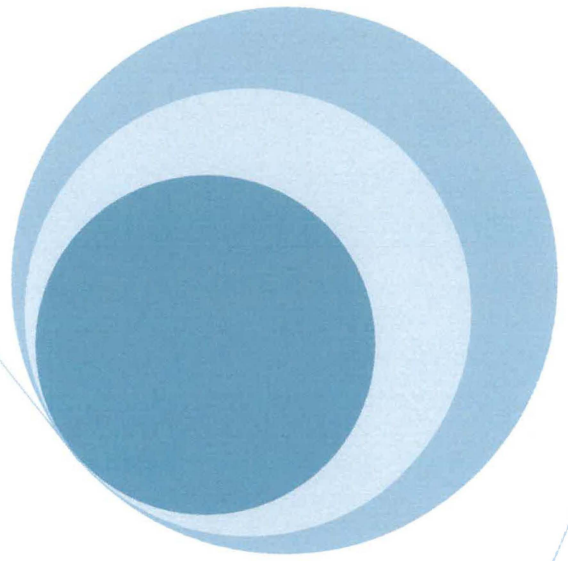


400 PATHWAYS

1. Longitudinal Grade


The maximum longitudinal grade for a pathway within the right-of-way shall be 1.0%.

2. Cross Slope

The maximum cross slope across a pathway within the right-of-way shall be 1.5%.

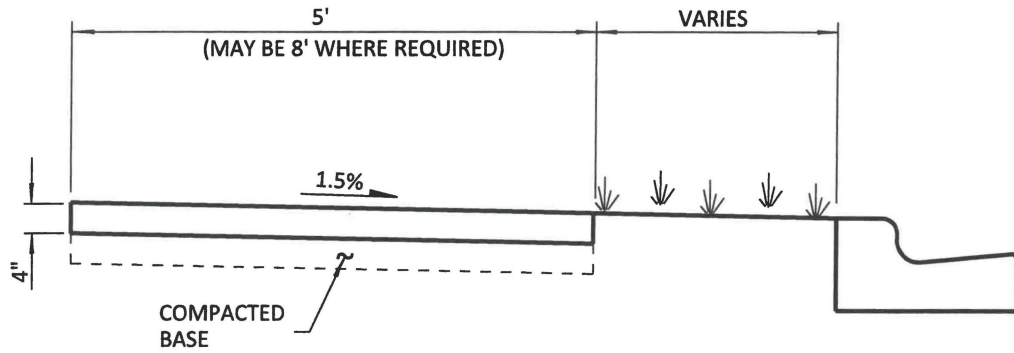

STANDARD SECTION

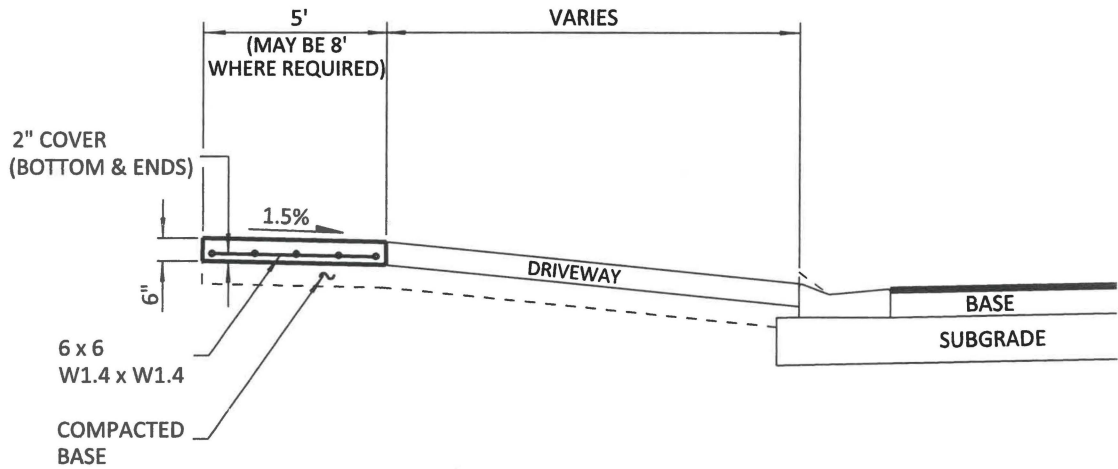


DRIVEWAYS (RESIDENTIAL AND NON-RESIDENTIAL AREAS)

NOTES:

1. SIDEWALKS TO BE PORTLAND CEMENT CONCRETE, MIN. 2500 P.S.I. @ 28 DAYS.
2. BASE TO BE A MINIMUM 4 INCHES OF CLEAN SAND OR SANDY LOAM, FULLY COMPACTED, FULL WIDTH.
3. SIDEWALKS TO BE BROOM FINISHED WITH EVEN, DUSTLESS SURFACE.
4. MAXIMUM LONGITUDINAL SLOPE IS 1.0%
5. SIDEWALK THICKNESS TO BE 6 INCHES MINIMUM IN ALL AREAS SUBJECT TO VEHICULAR TRAFFIC.

FILEPATH: P:/DGN/ENG SER/LAND DEVELOPMENT STANDARDS/DWF FORMAT/400.1A

PALM BEACH COUNTY DEPARTMENT OF ENGINEERING & PUBLIC WORKS				PATHWAY: CONCRETE SIDEWALK		DRAWING NO. 400.1

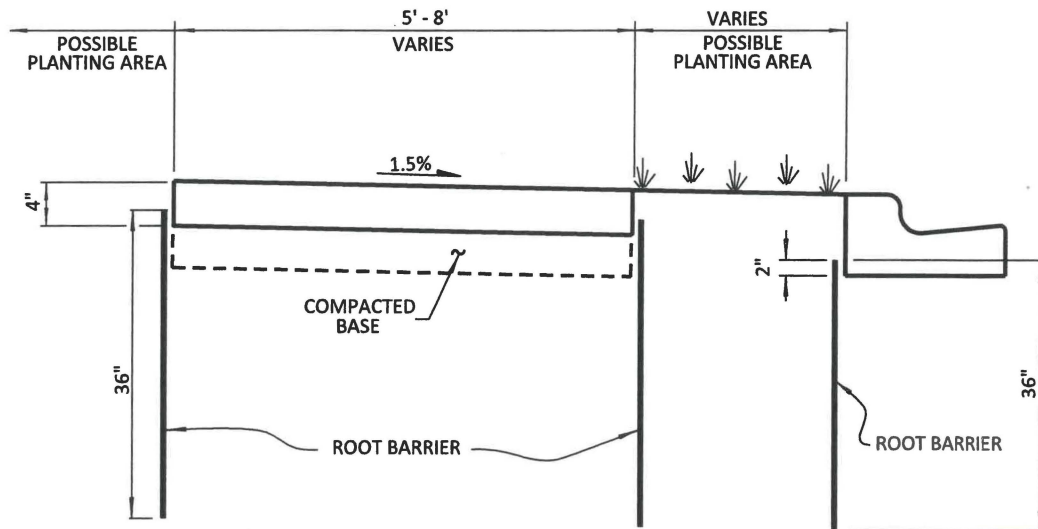


STANDARD SECTION

NOTES:

1. ROOT BARRIER IS REQUIRED FOR LOCATIONS WHERE TREE(S) AND/OR ASSOCIATED ROOTS ARE LOCATED WITHIN 10 FT. OF A REQUIRED IMPROVEMENT".
2. ROOT BARRIER MATERIAL SHALL BE HDPE OR AS OTHERWISE APPROVED BY THE COUNTY ENGINEER.
3. ROOT BARRIER INSTALLED 15 FT. ON CENTER OF TREE(S) AND/OR ROOTS.

FILEPATH: P:/DGN/ENG SER/LAND DEVELOPMENT STANDARDS/DWF FORMAT/400.1B

PALM BEACH COUNTY DEPARTMENT OF ENGINEERING & PUBLIC WORKS				PATHWAY WITH ROOT BARRIER		DRAWING NO. 400.2

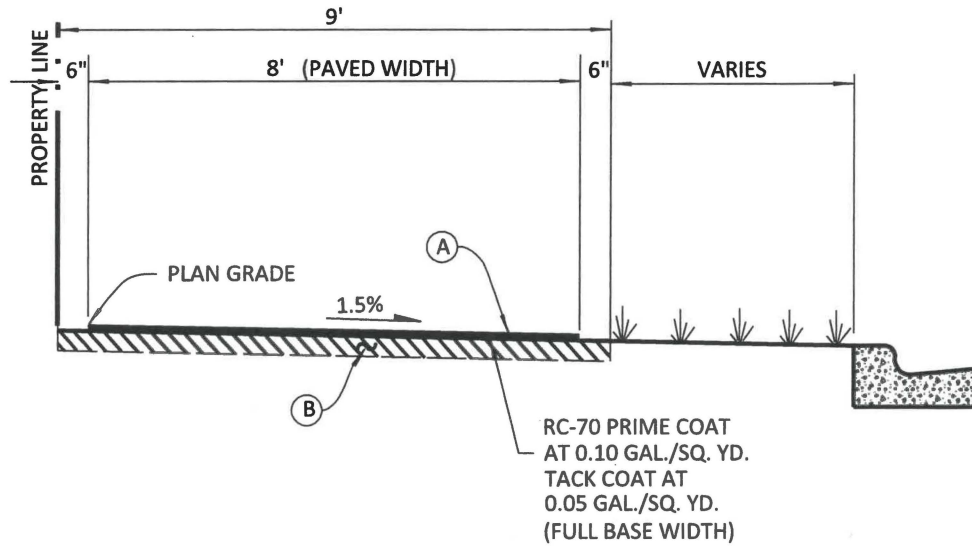

NOTE:
MAXIMUM LONGITUDINAL
SLOPE IS 1.0%

(A) **WEARING SURFACE:** 1 INCH TYPE S-3, OR 1¼ INCH TYPE S-1 OR TYPE II A.C. CONCRETE.

(B) **BASE:** 4 INCHES COMPACTED SHELLROCK.

FILEPATH: P:/DGN/ENG SER/LAND DEVELOPMENT STANDARDS/DWF FORMAT/400.2A

PALM BEACH COUNTY DEPARTMENT OF ENGINEERING & PUBLIC WORKS				PATHWAY: ASPHALT SIDEWALK		DRAWING NO. 400.3
DRAWN BY: K.L.	DATE: 05/23/90	REVISED BY: J.M.K.	DATE: 02/01/2018	APPROVED: <i>John A. Comell</i> COUNTY ENGINEER OR DESIGNEE	EFFECTIVE: <i>2/19/18</i>	