



# Commercial Kitchen Appliance Alignment Device Requirements




In accordance with the current edition of NFPA 17A: Standard for Wet Chemical Extinguishing Systems –“Movable cooking equipment shall be provided with a means to ensure that it is correctly positioned in relation to the appliance discharge nozzle during cooking operations.”

In addition, in accordance with the current edition of NFPA 96: Standard for Ventilation Control and Fire Protection of Commercial Cooking Operations - “An approved method shall be provided that will ensure that the appliance is returned to an approved design location.”



Regardless whether the kitchen appliance beneath the suppression system is on wheels or legs, the equipment shall be chained or cabled to the wall so that if for any reason the equipment is pulled away from the wall - the chain/cable will prevent the gas line from being pulled from it's couplings.

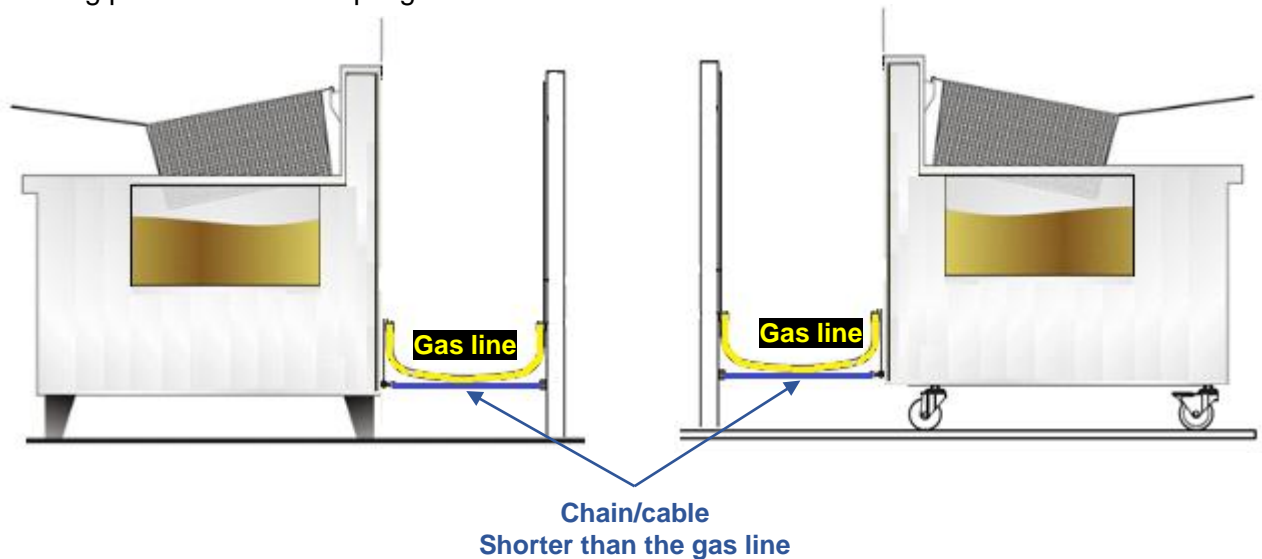

For more information on Fire Safety click here

CRRD

