

Table with columns: NO., DATE, REVISION, REMARKS, GENERAL REVISION, J.L., J.L.

STD DETAILS SHEET NUMBER 0 OF 0

SEAL

CONSULTANT: WUD

Table with 3 columns: A. Panel Builder, B. Panel Components, C. RTU Enclosure. Contains detailed specifications for panel construction, component materials, and enclosure requirements.

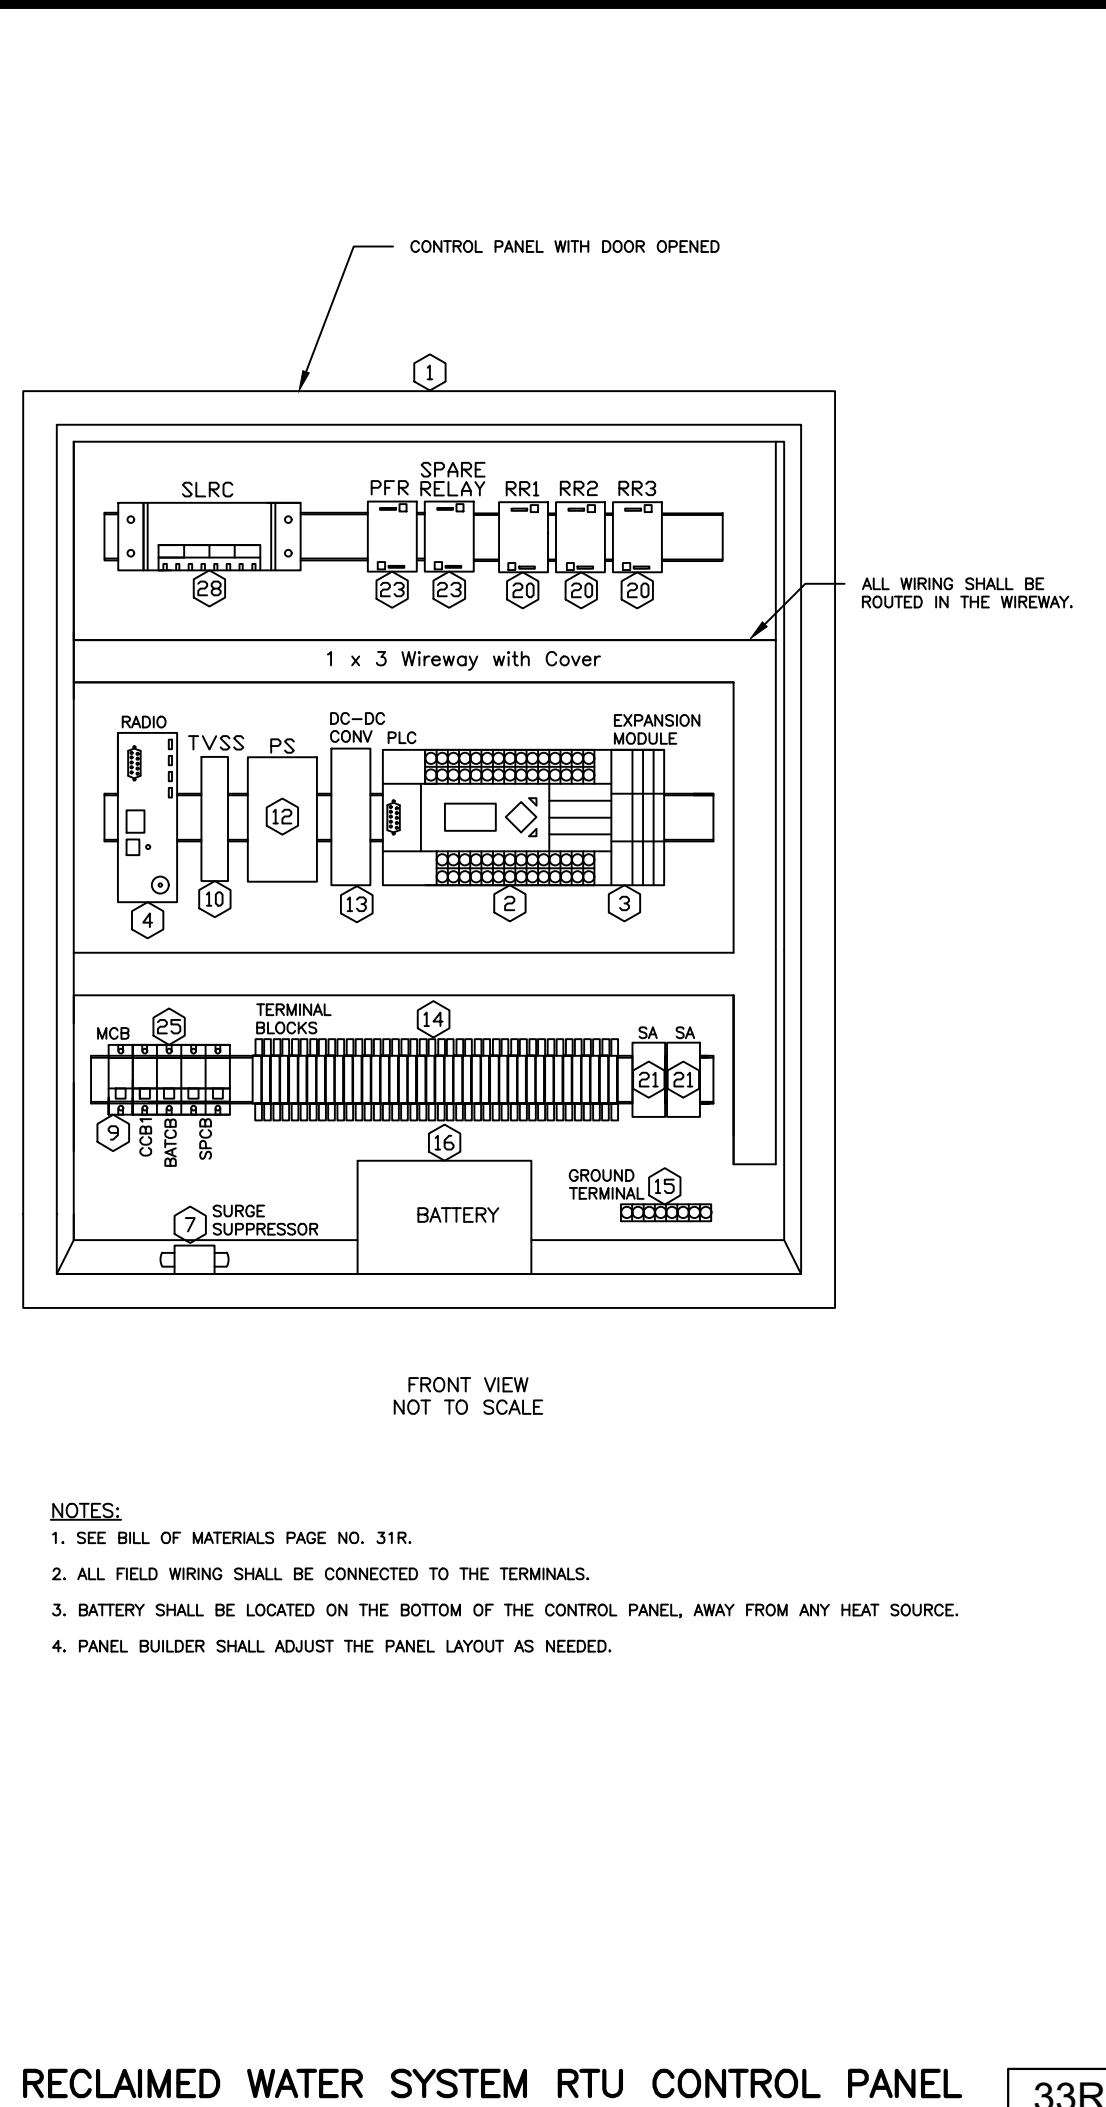


Table titled 'BILL OF MATERIALS (RECLAIMED CONTROL PANEL)'. Lists 30 items including PLC, expansion modules, antennas, breakers, relays, and power supplies with manufacturer and type information.

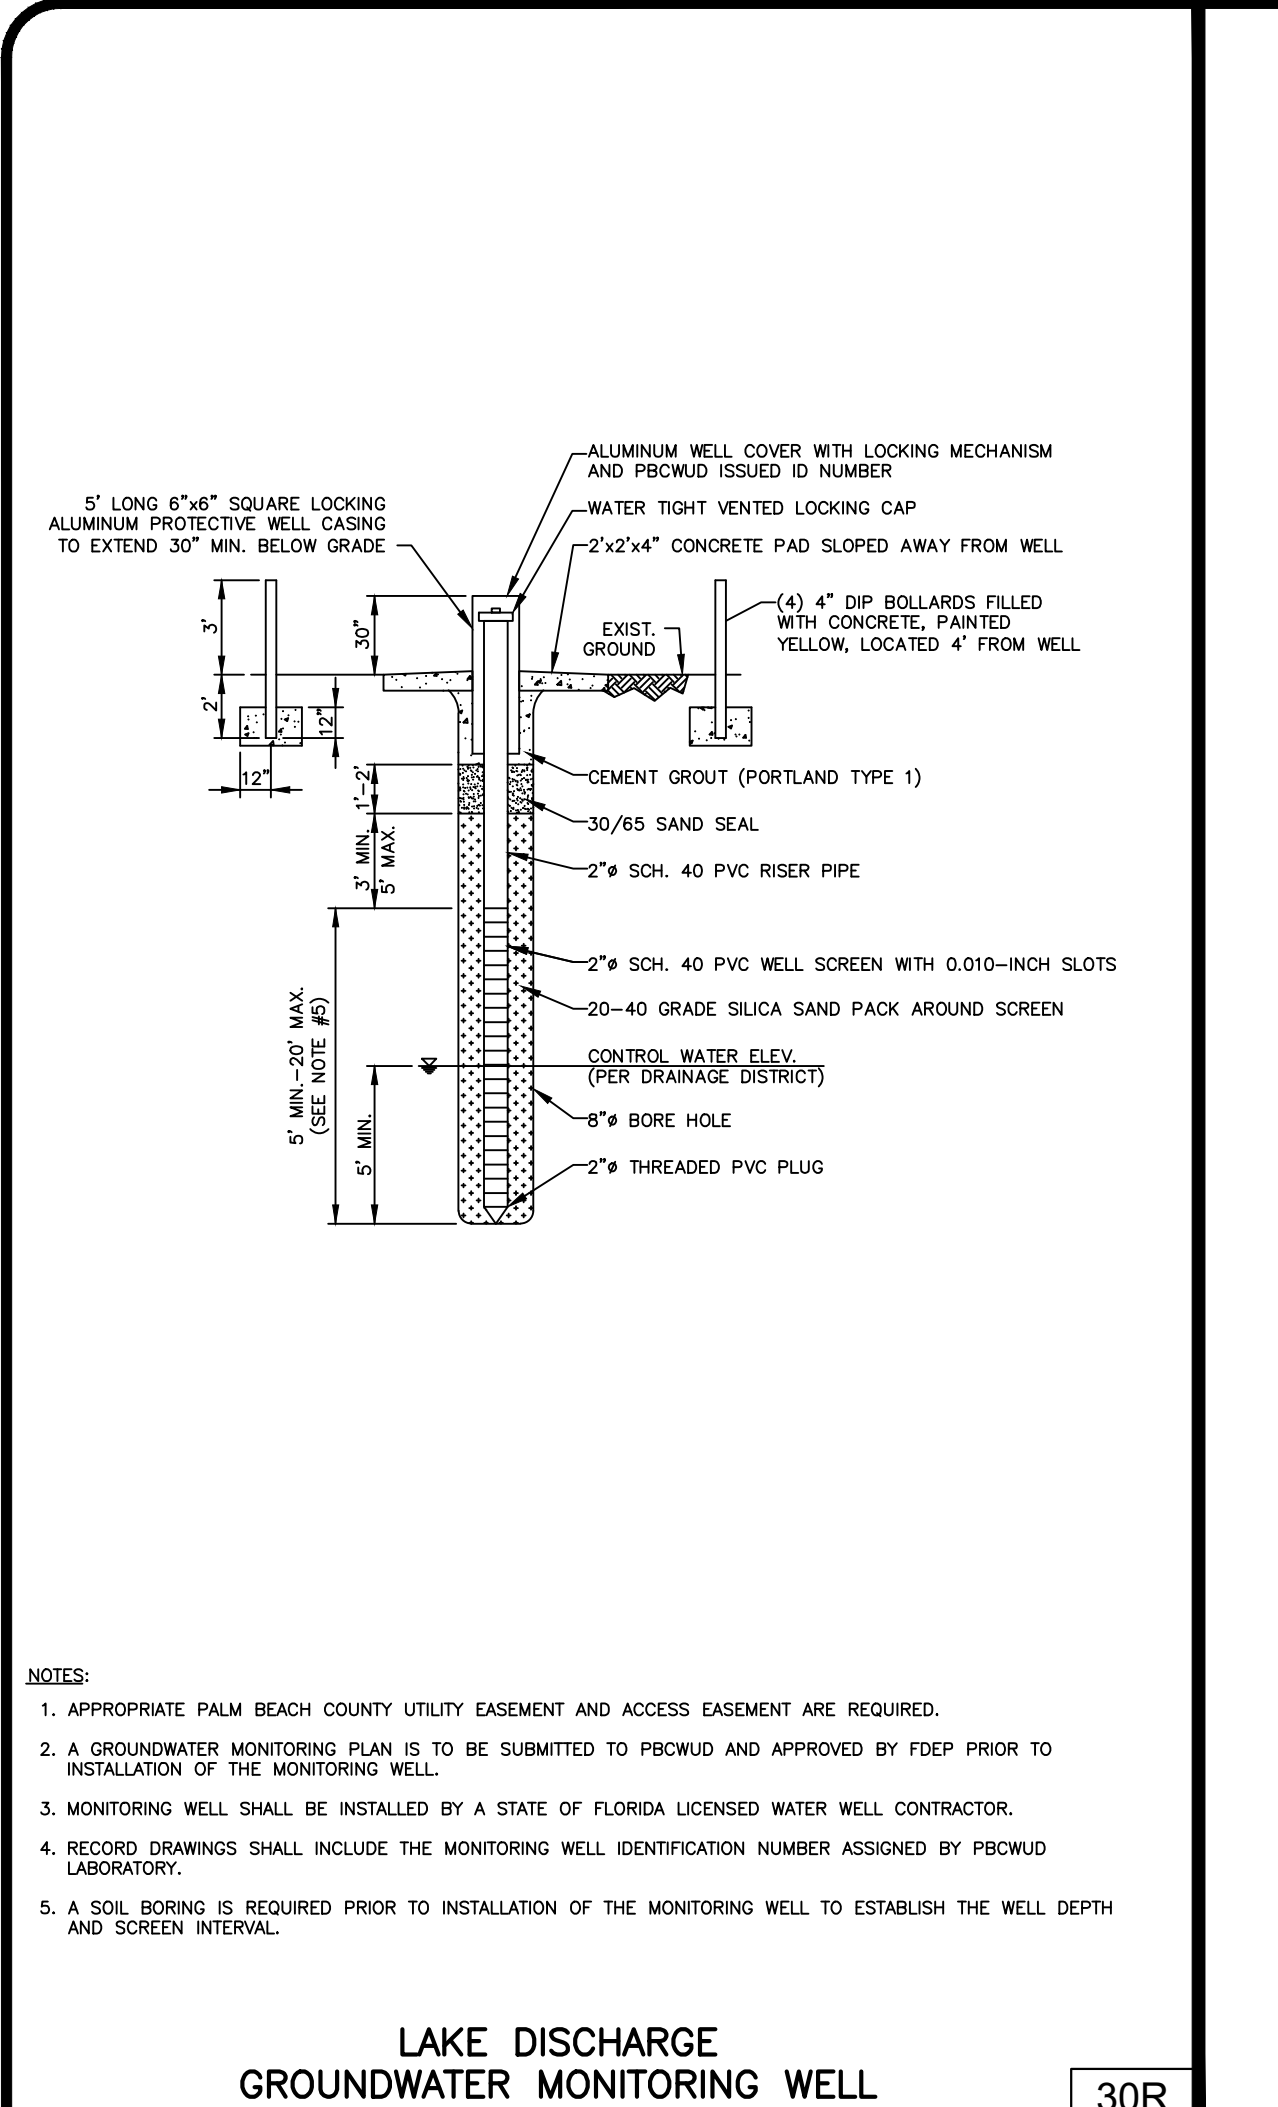
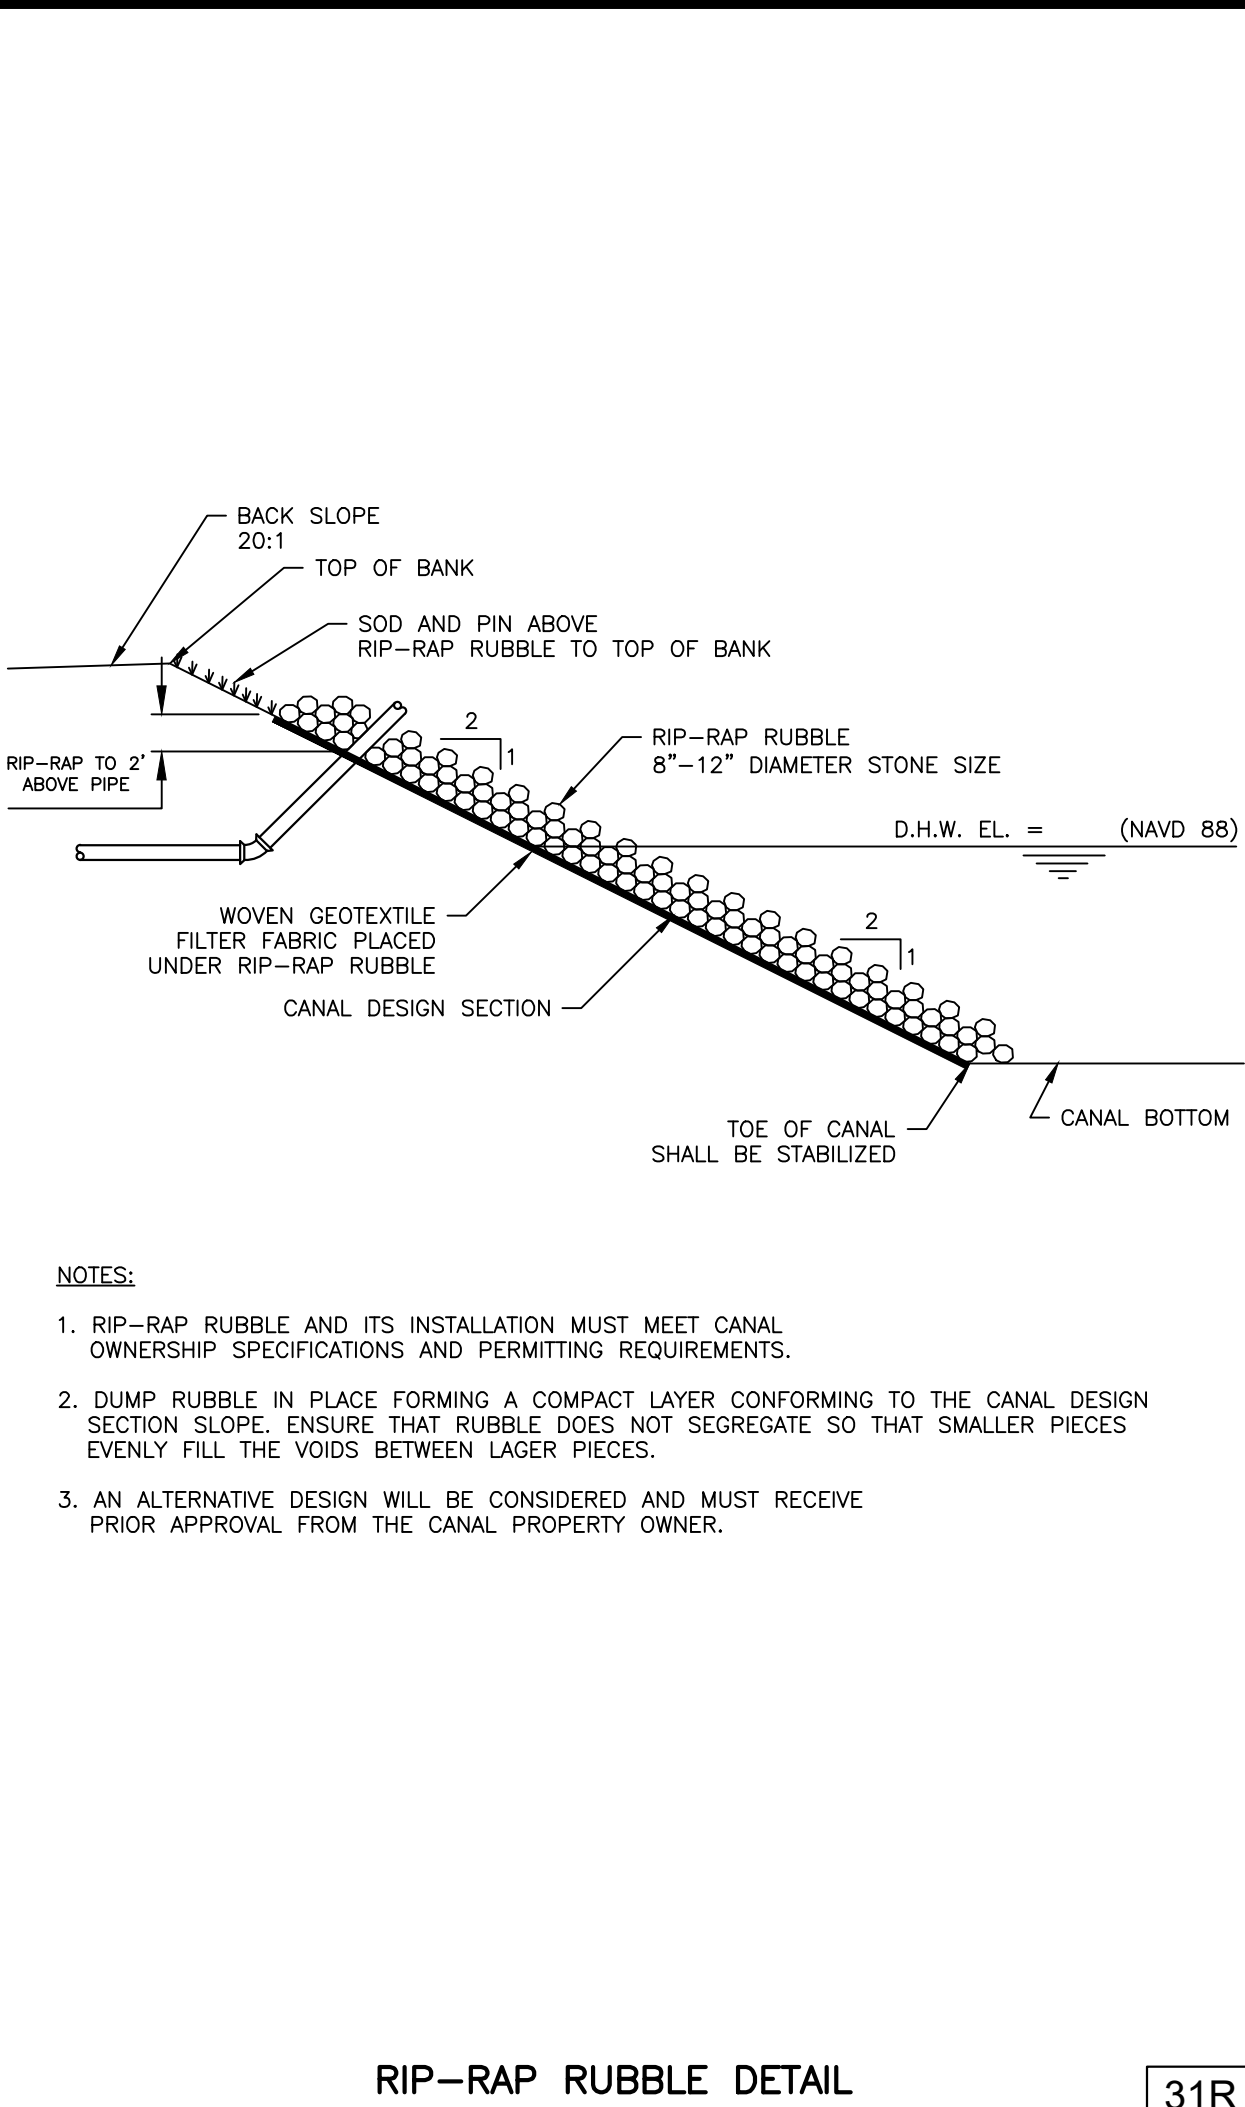


Table titled 'RECLAIMED WATER SYSTEM RTU PANEL SPECIFICATIONS'. Contains 35 rows of detailed specifications for the RTU panel, including materials, dimensions, and performance requirements.

Table titled 'RECLAIMED WATER SYSTEM RTU SPECIFICATIONS'. Contains 31 rows of detailed specifications for the RTU system, including remote telemetry units and communication interfaces.

Table titled 'RECLAIMED WATER SYSTEM RTU SPECIFICATIONS'. Contains 32 rows of detailed specifications for the RTU system, including radio section and antenna requirements.

Table titled 'RECLAIMED WATER SYSTEM RTU SPECIFICATIONS'. Contains 33 rows of detailed specifications for the RTU system, including surge suppressors and corrosion protection.

Complex block containing 'THIS SPACE INTENTIONALLY LEFT BLANK', 'RECLAIMED WATER #4 STANDARD DETAILS', and 'CONSULTANT: WUD'.