
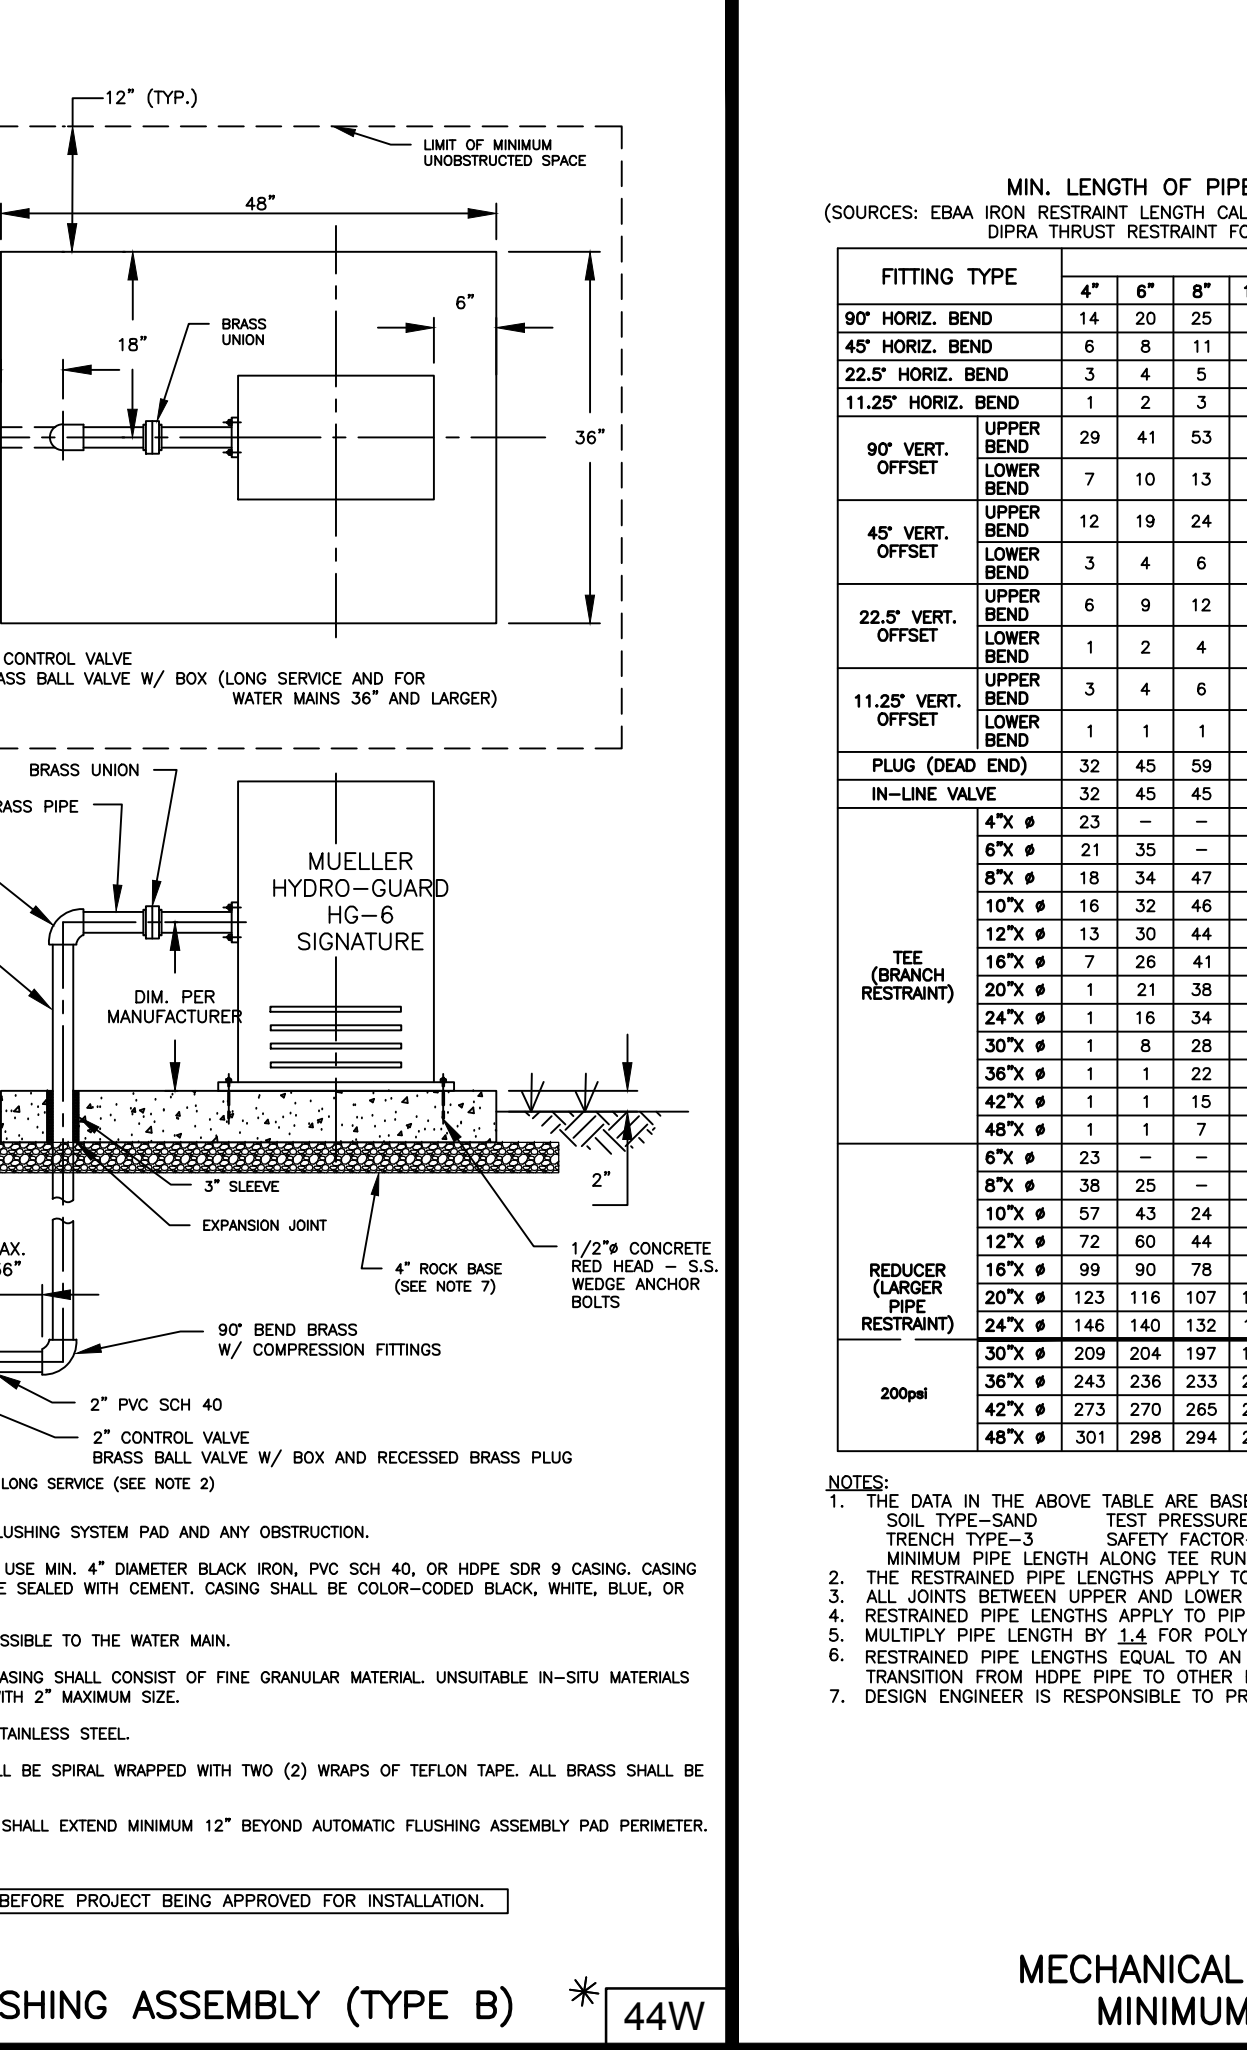
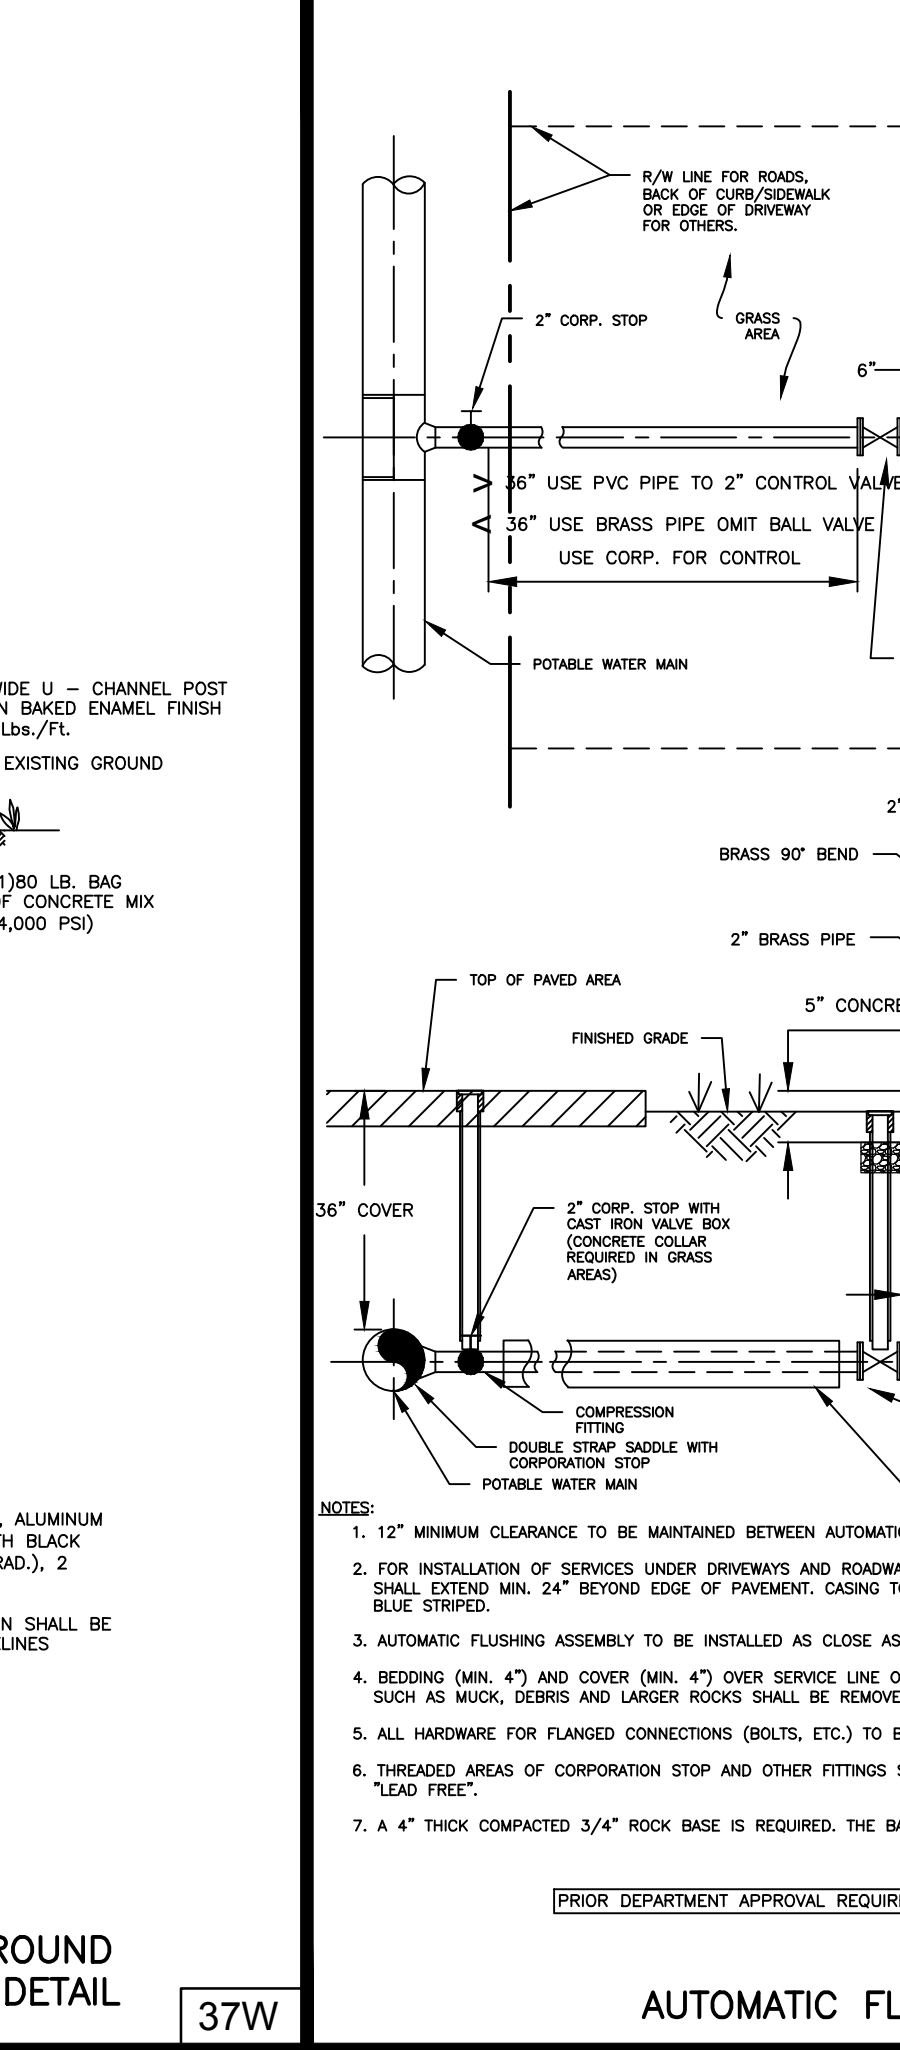
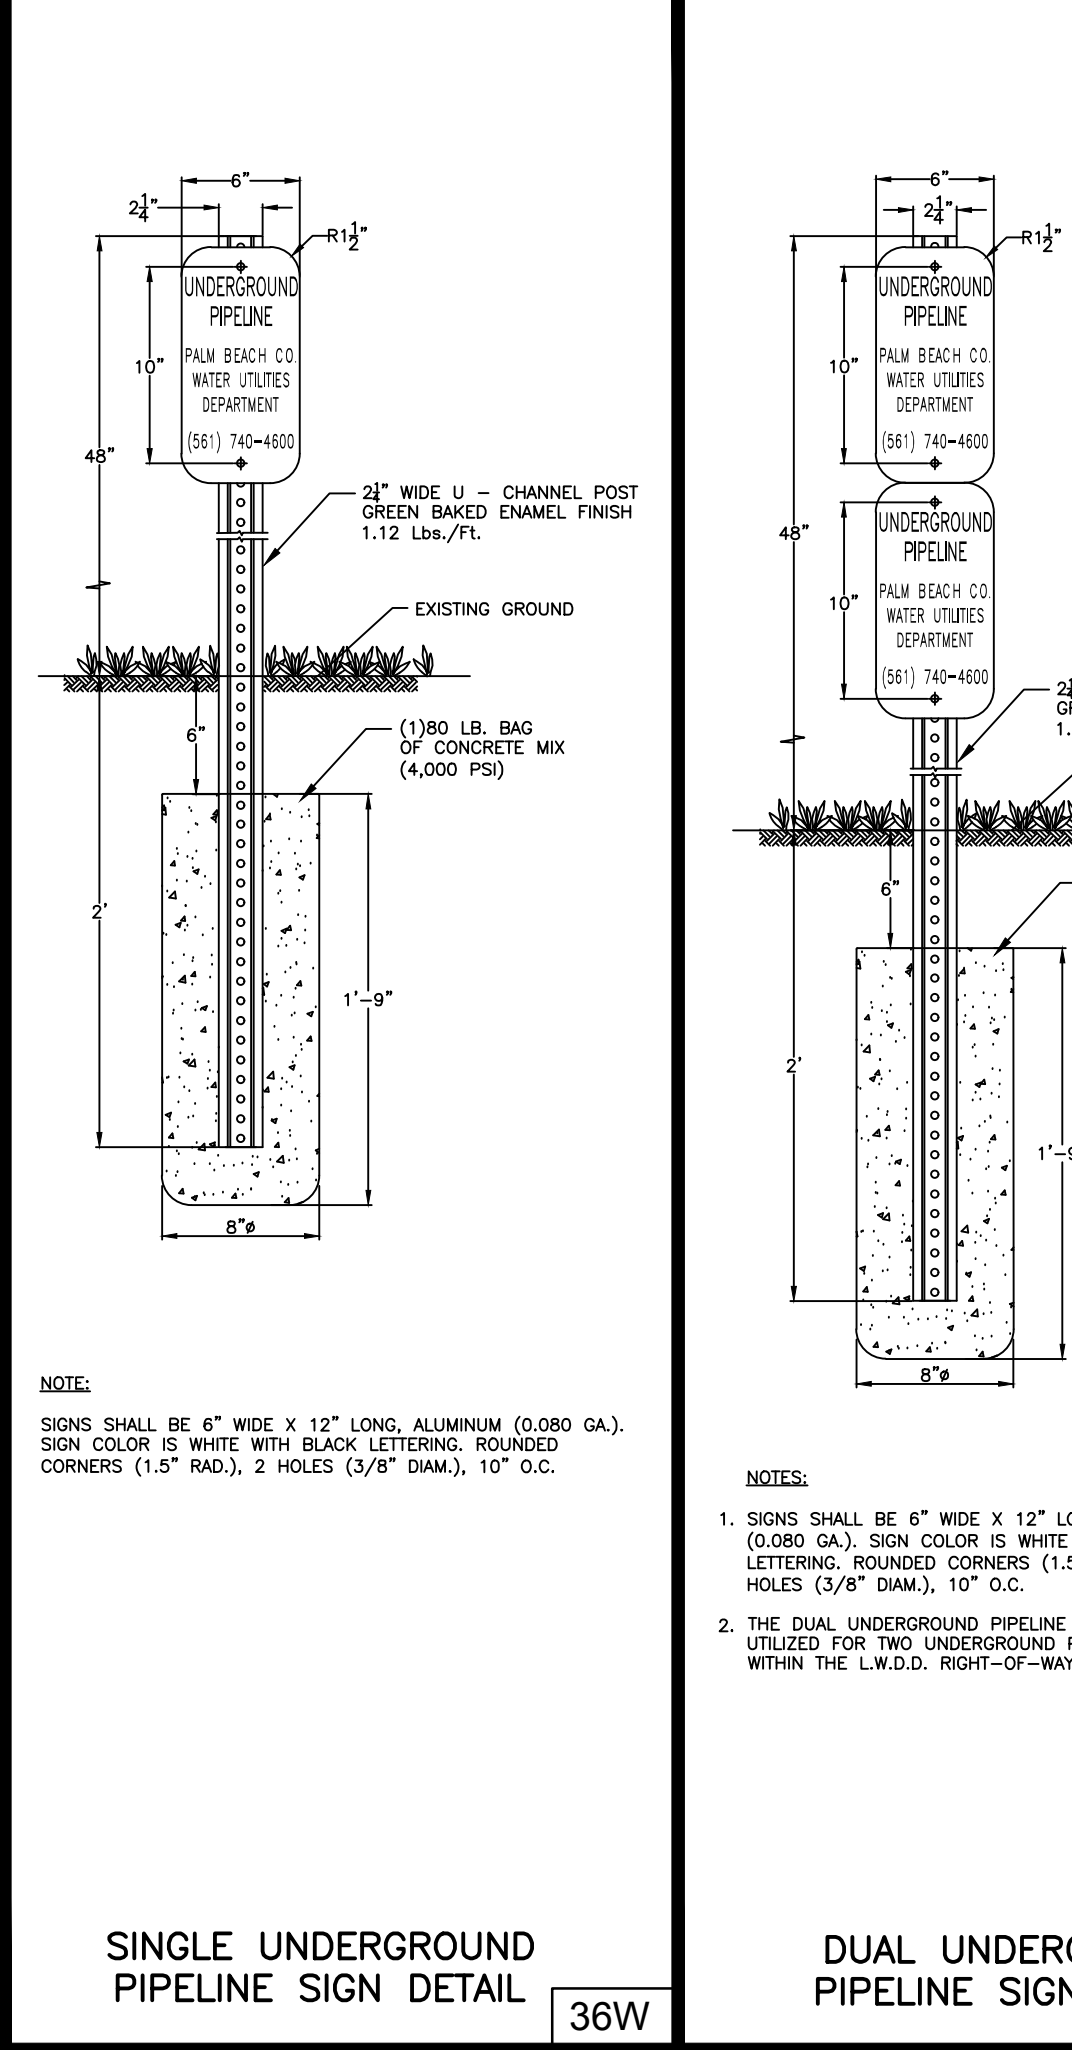


DEFINITIONS: 1. DEPARTMENT - THE PALM BEACH COUNTY WATER UTILITIES DEPARTMENT. 2. CONTRACTOR - PALM BEACH COUNTY AND ALL UTILITY SUBCONTRACTORS. 3. ENGINEER - ENGINEER RESPONSIBLE FOR INSPECTION AND CERTIFICATION. PROCEDURE: 1. A PRE-CONSTRUCTION MEETING IS TO BE HELD PRIOR TO DELIVERY OF MATERIALS...

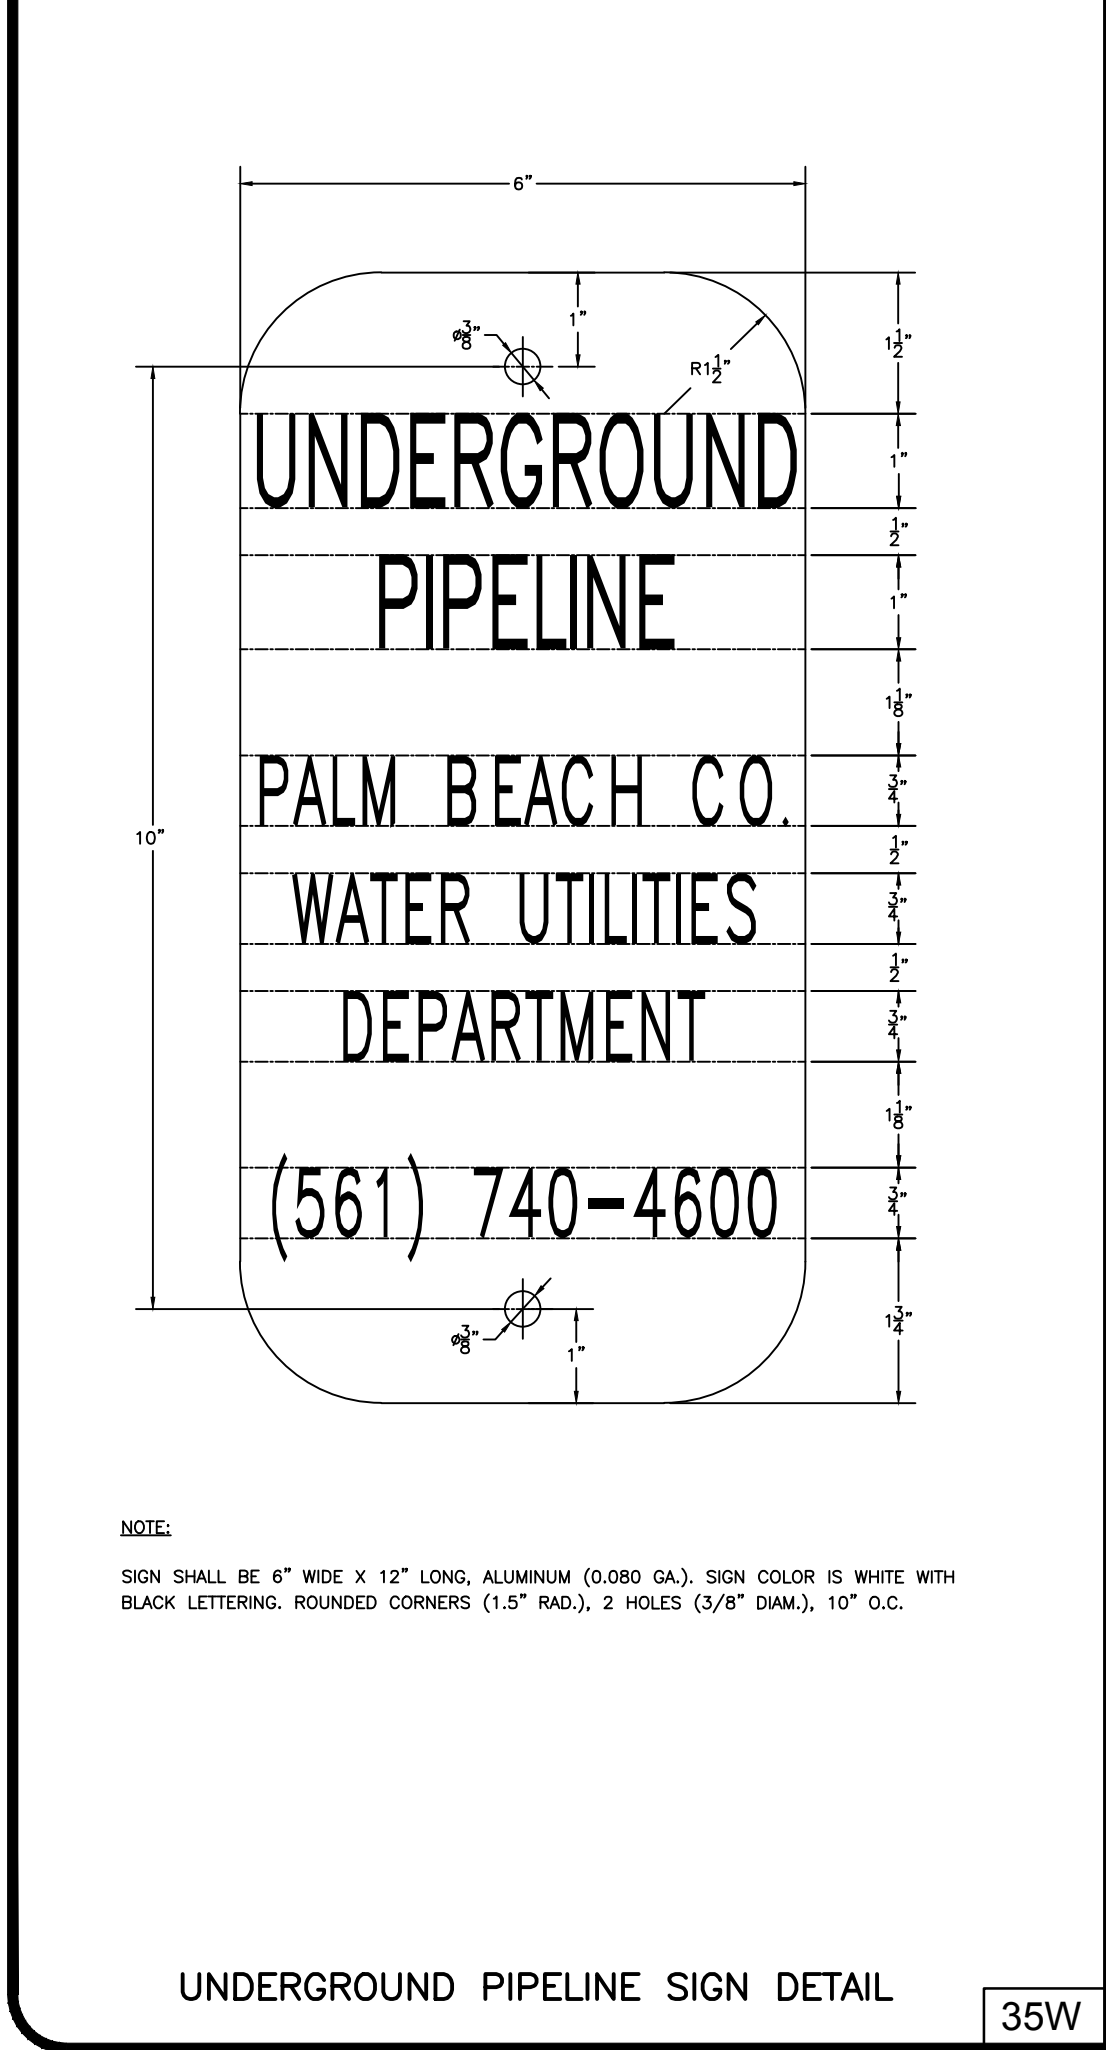

AUTOMATIC FLUSHING ASSEMBLY (TYPE B) * 44W

Table with columns for Fitting Type, Pipe Size, and Minimum Length of Pipe (Feet) to be Restrained. Includes notes on data sources and application.

MECHANICAL THRUST RESTRAINT MINIMUM PIPE LENGTHS 34W

Table: POTABLE WATER MAIN PRESSURE TEST CRITERIA. Columns for Avg. Test Pressure (PSI) and Maximum Quantity of Water (Gallons per Hour) for various pipe diameters and lengths.

POTABLE WATER #4 STANDARD DETAILS. CONSULTANT: WUD. DESIGNED BY: WUD. DRAWN BY: M. BUCKNER. CHECKED BY: J. LAMMERT. APPROVED BY: WUD.

IT'S THE LAW! CALL 48 HOURS BEFORE YOU DIG 1-800-432-4770. SUNSHINE STATE ONE CALL OF FLORIDA, INC. UTILITIES NOTIFICATION CENTER.